Mounting Instruction

■ Product Parameters



1. Model:T-00H1-300
2. Pole Lten:T-00H1-H
3. Rated Voltage:
4. Rated Power:
5. IP Grade:
6. Insulation protection level: Class I
7. Operating Temperature: -30～+45℃

■ Components and Tools

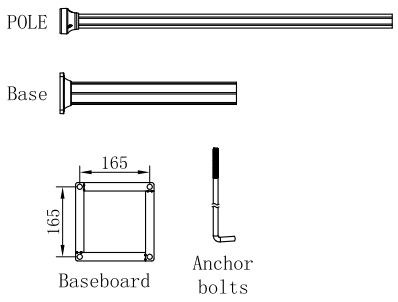

Flange

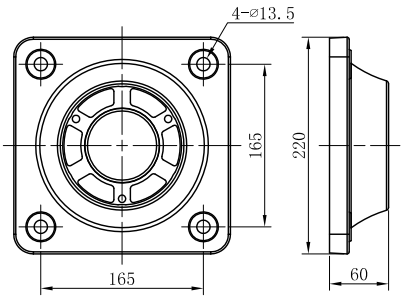

Mounting holes

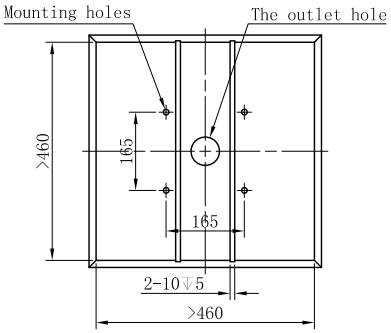

■ Installation Steps

A

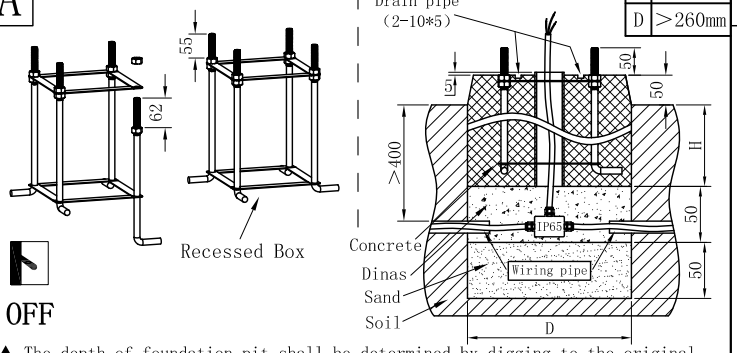

▲ The depth of foundation pit shall be determined by digging to the original soil. In case of backfill, the recessed box can be embedded only after water injection and settlement.

▲ After the recessed box are embedded for 72H (3 days), shall the lamp be mounted only when the concrete is completely solidified.

B

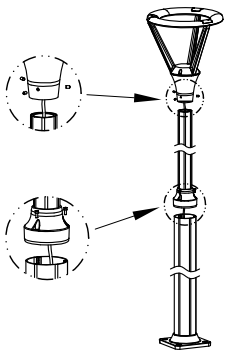

C

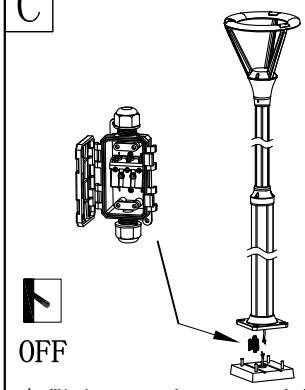

▲ Wiring must be operated in accordance with construction specifications.

D



▲ Please be sure to fasten tightly of the flange.

E



▲ Connect the power supply,and light up the lamp.

F

G

■ Attention

1. Lamp should be installed by professional electrician;
2. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person;
3. Check the power switch has been turned off;
4. Please read this user guide carefully before installation and keep for future reference;
5. If the erternal flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.